

Program: RFEM 5, RWIND Simulation

Category: Fluid Mechanics

Verification Example: 1010 – Wind Loads on Flat Roof Building

1010 – Wind Loads on Flat Roof Building

Description

This verification example compares wind load calculations on a flat roof building with analytical equations per the ASCE/SEI 7-16, the automatically generated wind loads in RFEM [1] and CFD simulation in RWIND Simulation. The building is defined according to **Figure 1** and the inflow velocity profile is defined according the standard ASCE/SEI 7-16, in **Figure 2**. The problem is described by the following table:

Fluid Properties	Kinematic Viscosity	ν	0.000161	ft^2/s
	Density	ρ	0.078	lb/ft^3
Geometry	Width	b	35.000	ft
	Height	h	28.000	ft
	Length	L	47.000	ft
ASCE/SEI 7-16 Settings	Exposure Category	D	-	-
	Wind Speed	V	100.000	mph
	Topographic factor	K_{zt}	1.000	-
	Ground Elevation factor	K_e	1.000	-
	Wind Directionality factor	K_d	0.850	-
	Gust-effect factor	G	0.850	-

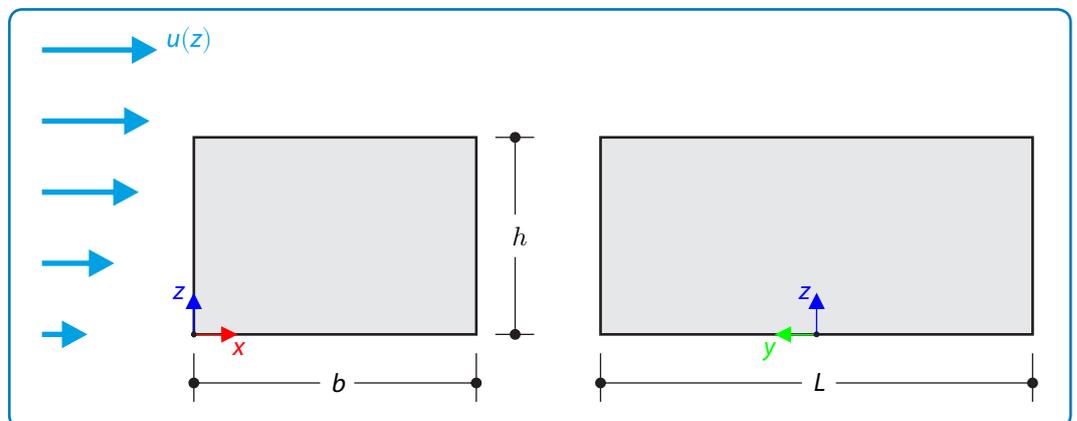


Figure 1: Problem sketch

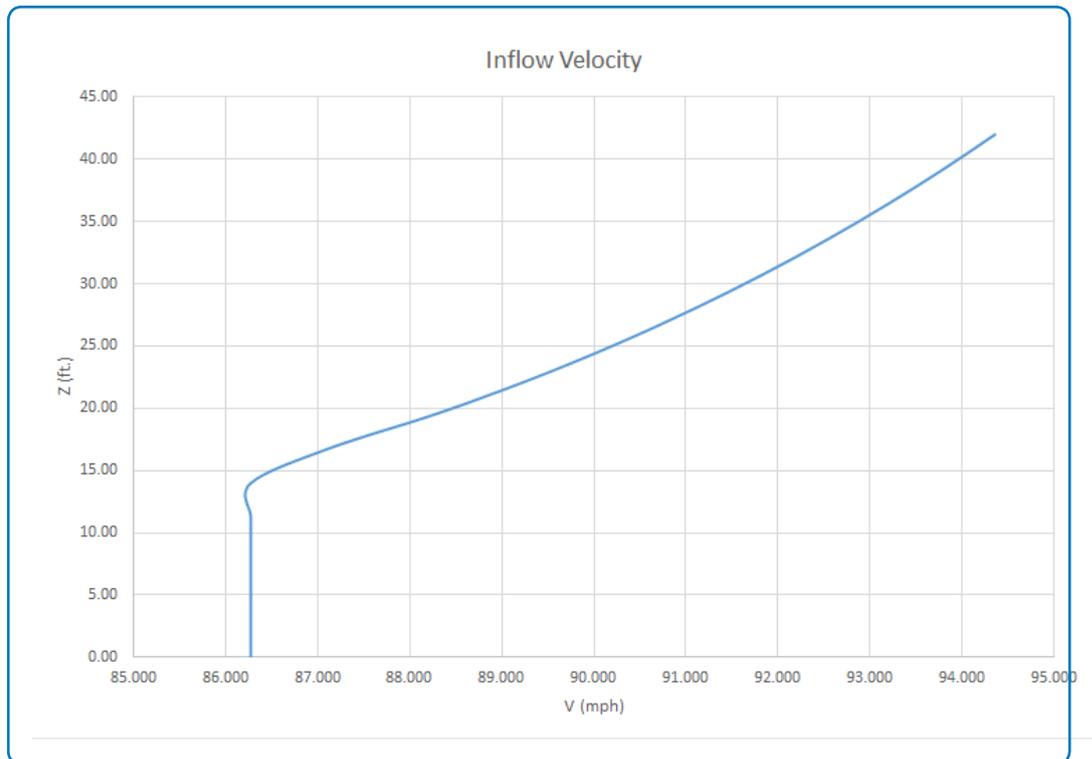


Figure 2: Inflow velocity according to ASCE/SEI 7-16 (exposure category D, basic wind speed 100 mph)

RFEM Wind Load Generator Settings

- Modeled in RFEM 5.22.03 utilizing the Wind Load Generator - vertical walls with roof tool
- Only Case 1 from Fig. 27.3-8 [1] is considered
- The windward roof pressure coefficient (C_p) is taken as the first value given in Figure 27.3-1 [1]

RWIND Simulation Settings

- Modeled in RFEM 5.22.03 and RWIND Simulation 1.21
- Turbulence model: $k-\varepsilon$

Remark: The calculation parameters according to the ASCE/SEI 7-16 are chosen for closely correlated CFD analysis results.

Analysis

This verification example will utilize the steps and analytical equations described in Table 27.2-1 [1] from the ASCE/SEI 7-16 for the MWFRS wind loads on an enclosed building. The steps for this calculation are listed below.

Step 1: Determine the risk category of the building by referencing Table 1.5-1 [1].

Assuming the building's failure could pose a substantial risk to human life; a Risk Category of III is selected.

Step 2: Determine the basic wind speed (V) for the applicable risk category by referencing Figure 26.5-1 and 26.5-2 [1].

$$V = 100.000 \text{ mph.}$$

Verification Example: 1010 – Wind Loads on Flat Roof Building

Step 3: Determine the following wind load parameters:

- The wind Directionality Factor (K_d) is determined from Sect. 26.6 and Table 26.6-1 [1].

$$K_d = 0.850$$

- The Exposure Category is determined using Sect. 26.7 [1].

Exposure D is selected due to the smooth surrounding topography so wind is unobstructed.

- To calculate the Topographic variable (K_{zt}) see Section 26.8 and table in Fig. 26.8-1 [1].

$K_{zt} = 1.000$, assuming the site conditions and locations of buildings and other structures do not meet all the conditions specified in Sect. 26.8.1 [1].

- The Ground Elevation factor (K_e) is determined from Sect. 26.9 [1].

$$K_e = 1.000, \text{ assuming sea level} = 0 \text{ ft}$$

- Gust-effect factor (G or G_f) is determined using Sect. 26.11 [1].

$$G = 0.850$$

- Enclosure classification is determined using Sect. 26.12 [1].

Enclosed building

- To determine the internal pressure coefficient (GC_{pi}) see Sect. 26.13 and Table 26.13-1 [1].

$$GC_{pi} = \pm 0.180$$

Step 4: Determine the Velocity Pressure Exposure coefficient (K_z or K_h); see Table 26.10-1 [1]. A more accurate calculation is performed using the equation from Note 1.

Exposure D, ($a = 11.5$ and $Z_g = 700$)

$$K_z(\text{windward}) = 1.030 \text{ (} z = 0 - 15\text{ft.)}, K_h(\text{windward}) = 1.148 \text{ (Roof)},$$

Step 5: Determine the Velocity Pressure (q_z and q_h) using Eqn. (26.10-1) [1].

$$q = 0.00256 \cdot K_z \cdot K_{zt} \cdot K_d \cdot K_e \cdot V^2 \quad (1010 - 1)$$

$$q_z = 22.417 \text{ psf (} z = 0 - 15\text{ft.)}, q_h = 23.568 \text{ psf (Roof)},$$

Step 6: Determine external pressure coefficients (C_p or C_N) on the walls and roof.

Verification Example: 1010 – Wind Loads on Flat Roof Building

$$C_p = 0.8 \text{ (windward)}, C_p = -0.5 \text{ (leeward)}, C_p = -0.7 \text{ (sidewall)}$$

$$h/L = 0.80$$

$$C_p = -1.14 \text{ (} 0 - h/2 \text{)}, C_p = -0.78 \text{ (} h/2 - h \text{)}, C_p = -0.62 \text{ (} h - 2h \text{)}, C_p = -0.54 \text{ (} > 2h \text{)}$$

Step 7: Calculate the Wind Pressure, (P), on each building surface using Eqn. (27.3-1) [1].

$$P = q \cdot G \cdot C_p - q_i \cdot (GC_{pi}) \quad (1010 - 2)$$

LC1 (-GC_{pi}):

$$\text{Windward: } P = q_z \cdot G \cdot C_p - q_h \cdot (GC_{pi})$$

$$P = 19.740 \text{ psf (} z = 0 - 15\text{ft.)}, p = 21.483 \text{ psf (} z = 28.00\text{ft.)}$$

$$\text{Leeward: } P = q_z \cdot G \cdot C_p - q_z \cdot (GC_{pi})$$

$$P = -6.120 \text{ psf (} z = 28.00\text{ft.)}$$

$$\text{Sidewall: } P = q_h \cdot G \cdot C_p - q_h \cdot (GC_{pi})$$

$$P = -10.367 \text{ psf (} z = 28.00\text{ft.)}$$

$$\text{Roof: } P = q_h \cdot G \cdot C_p - q_h \cdot (GC_{pi})$$

$$P = -19.710 \text{ psf (} 0 - h/2 \text{)}$$

$$P = -12.065 \text{ psf (} h/2 - h \text{)}$$

$$P = -8.668 \text{ psf (} h - 2h \text{)}$$

$$P = -6.969 \text{ psf (} > 2h \text{)}$$

Verification Example: 1010 – Wind Loads on Flat Roof Building

LC2 (+GC_{pi}):

Windward: $P = q_z \cdot G \cdot C_p - q_h \cdot (GC_{pi})$

$$P = 10.747 \text{ psf } (z = 0 - 15\text{ft.}), p = 12.490 \text{ psf } (z = 28\text{ft.})$$

Leeward: $P = q_z \cdot G \cdot C_p - q_z \cdot (GC_{pi})$

$$P = -15.113 \text{ psf } (z = 28.00\text{ft.})$$

Sidewall: $P = q_h \cdot G \cdot C_p - q_h \cdot (GC_{pi})$

$$P = -10.367 \text{ psf } (z = 28.00\text{ft.})$$

Roof: $P = q_h \cdot G \cdot C_p - q_h \cdot (GC_{pi})$

$$P = -28.702 \text{ psf } (0 - h/2)$$

$$P = -21.058 \text{ psf } (h/2 - h)$$

$$P = -17.661 \text{ psf } (h - 2h)$$

$$P = -15.962 \text{ psf } (> 2h)$$

Results

Structure Files	Program
1010	ASCE/SEI 7-16 (Hand calculations)
1010	ASCE/SEI 7-16 (RFEM wind load generator)
1010	RWIND Simulation (inflow velocity according to ASCE/SEI 7-16)

Verification Example: 1010 – Wind Loads on Flat Roof Building

Quantity	ASCE/SEI 7-16 Hand calculations (LC1)	ASCE/SEI 7-16 RFEM Wind load generator (LC1)	Ratio
F_x [kip]	35.096	35.086	1.000
F_y [kip]	0.000	0.000	-
F_z [kip]	23.760	23.754	1.000

Quantity	ASCE/SEI 7-16 Hand calculations (LC1)	RWIND Simulation	Ratio
F_x [kip]	35.096	38.147	0.920
F_y [kip]	0.000	-0.381	-
F_z [kip]	31.156*	29.046	0.932

*Note: RWIND Simulation does not consider internal pressure coefficients (GC_{pi}). Therefore, the value from the analytical equation LC1 and LC2 were averaged for a more accurate comparison to RWIND Simulation.

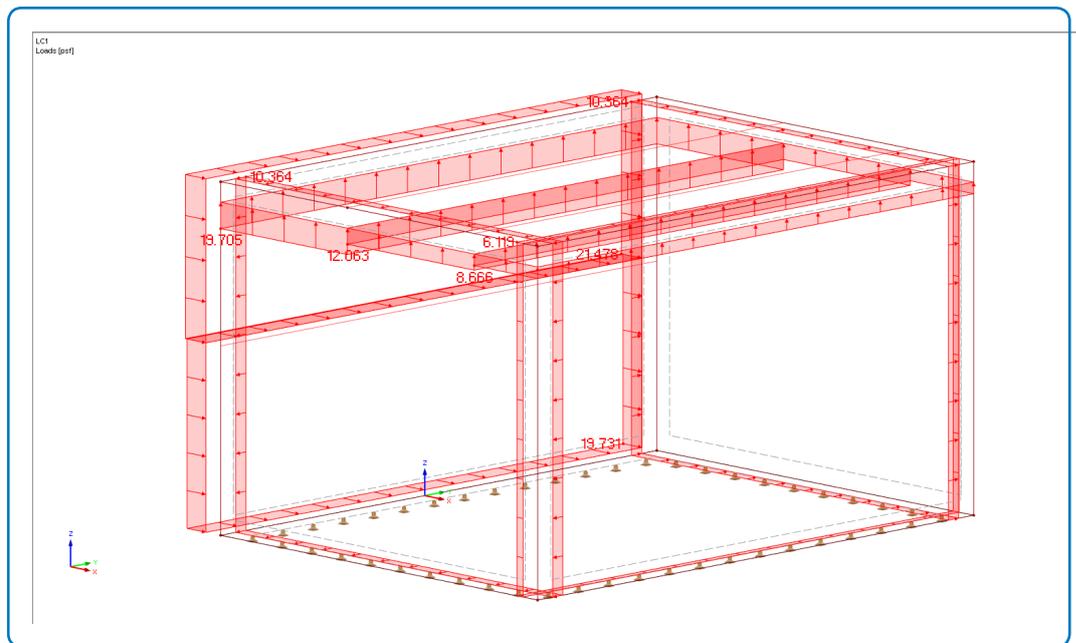


Figure 3: RWIND Wind Load Generator – LC1 Surface pressure

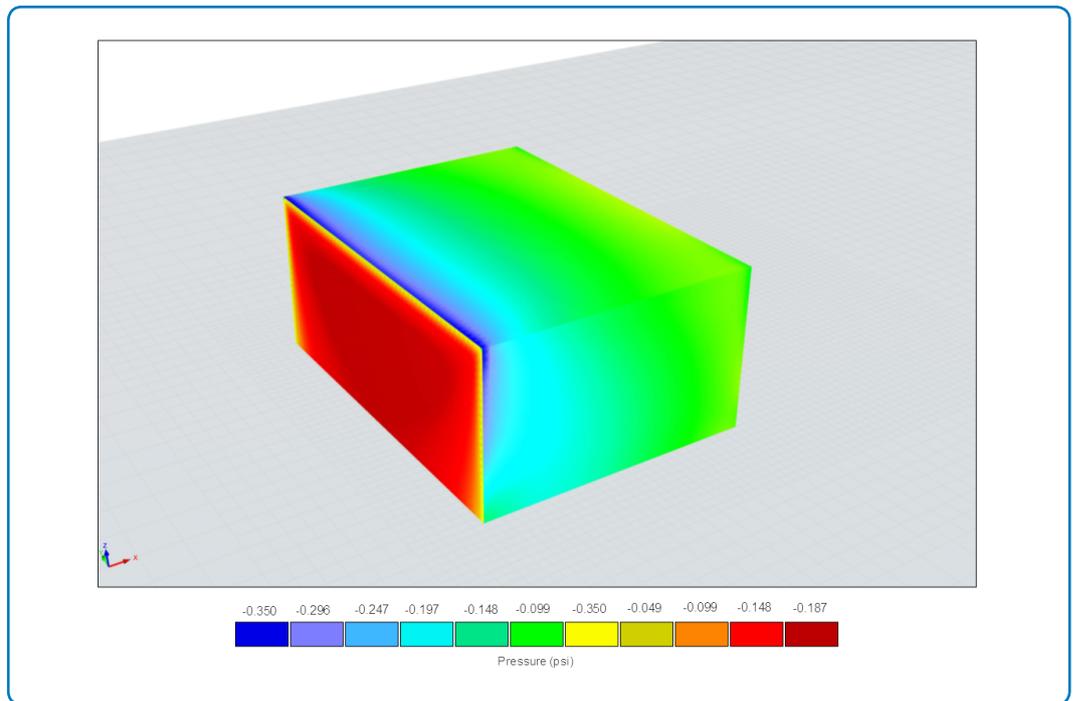


Figure 4: RWIND Simulation – Surface pressure

References

- [1] Minimum Design Loads and Associated Criteria for Buildings and Other Structures. ASCE/SEI 7-16, American Society of Civil Engineers, 2017.